


EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 148.49 lm/W			
MODEL		I _{max} (cd)	928.8	S/MH(C0/180)	1.33
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	1.29
RATED VOLTAGE(V)	120-277	TOTAL FLUX(lm)	2896.2	h UP, DN(C0-180)	0.0,48.6
NOMINAL FLUX(lm)	2896.21	CIE CLASS	DIRECT	h UP, DN(C180-360)	0.0,51.4
LAMPS INSIDE	1	h up(%)	0.0	CIBSE SHR NOM	1.50
TEST VOLTAGE(V)	120	h down(%)	100.0	CIBSE SHR MAX	1.50

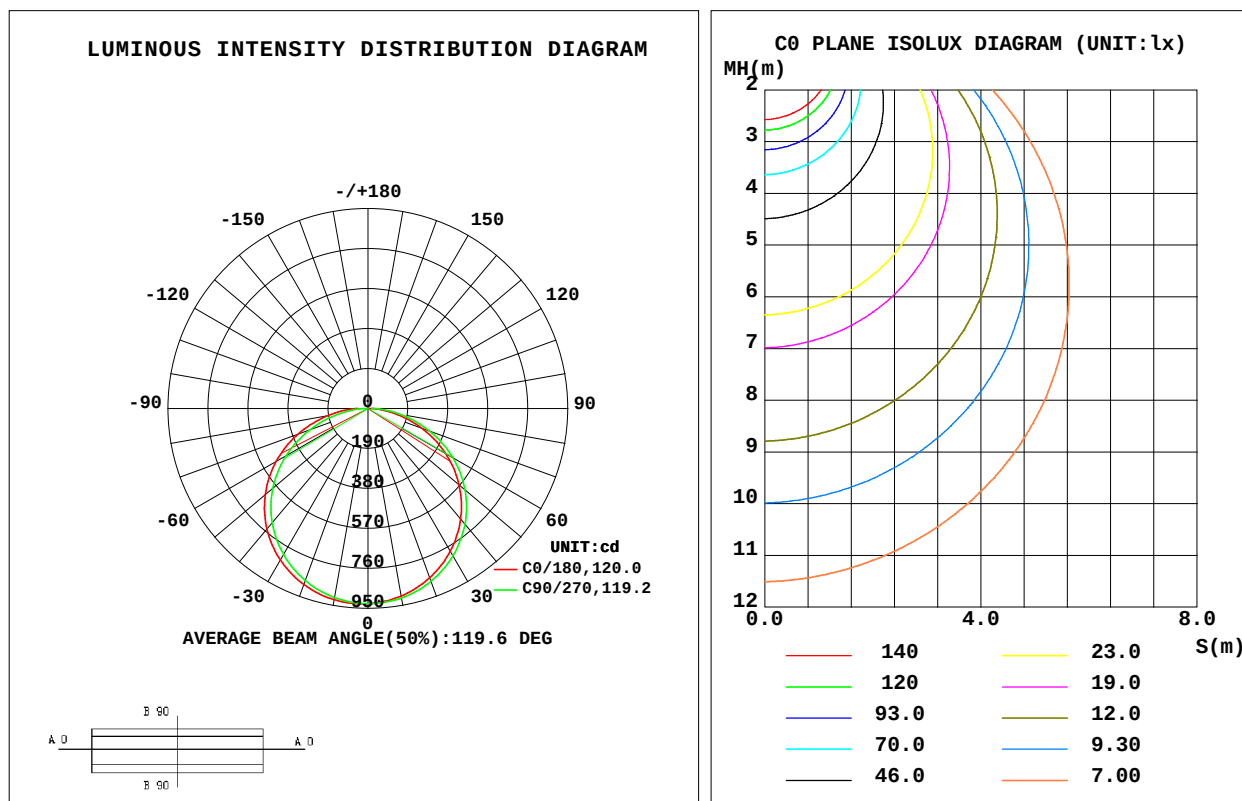

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:13 March 2024

α Range: 0 - 90DEG
α Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

g	C0	C90	C180	C270					g	F zone	F total	%lum, lamp
10	904.9	914.7	922.7	912.5					0- 10	87.87	87.87	3.03, 3.03
20	856.4	874.5	890.7	870.5					10- 20	253.3	341.1	11.8, 11.8
30	782.7	808.3	832.5	801.9					20- 30	388.7	729.8	25.2, 25.2
40	684.9	717.4	747.3	708.4					30- 40	477.9	1208	41.7, 41.7
50	565.5	602.8	637.9	591.4					40- 50	508.9	1717	59.3, 59.3
60	424.8	465.3	504.3	449.7					50- 60	475.9	2193	75.7, 75.7
70	269.9	307.9	350.8	290.8					60- 70	380.2	2573	88.8, 88.8
80	118.0	149.3	190.4	131.4					70- 80	237.7	2810	97, 97
90	0	19.23	45.67	7.975					80- 90	85.77	2896	100, 100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		


C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINANCE LIMITATION CURVES

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

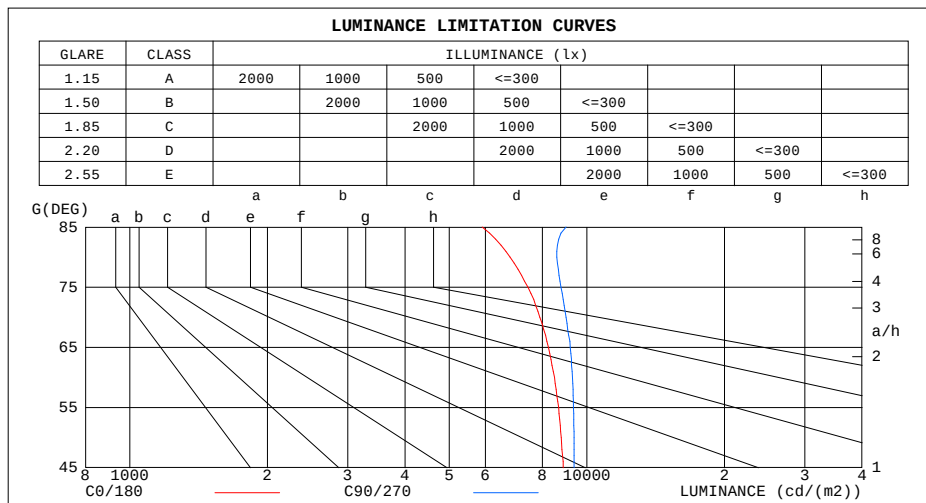

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	5908	9007
80	6795	8596
75	7439	8779
70	7893	9004
65	8247	9206
60	8495	9305
55	8674	9356
50	8797	9378
45	8878	9378

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024


g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

r cc	80%			70%			50%			30%			10%			0
r w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r fc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.03	.98	.94	1.01	.96	.93	.96	.93	.90	.92	.89	.87	.89	.86	.84	.82
2.0	.89	.82	.76	.87	.80	.75	.83	.78	.73	.80	.75	.71	.77	.73	.70	.67
3.0	.78	.69	.62	.76	.68	.62	.73	.66	.61	.70	.64	.60	.68	.63	.59	.56
4.0	.69	.59	.52	.67	.59	.52	.65	.57	.51	.62	.56	.51	.60	.55	.50	.48
5.0	.61	.52	.45	.60	.51	.45	.58	.50	.44	.56	.49	.44	.54	.48	.43	.41
6.0	.55	.46	.39	.54	.45	.39	.52	.44	.38	.50	.43	.38	.49	.43	.38	.36
7.0	.50	.41	.34	.49	.40	.34	.47	.40	.34	.46	.39	.34	.44	.38	.33	.31
8.0	.45	.37	.31	.45	.36	.30	.43	.36	.30	.42	.35	.30	.41	.34	.30	.28
9.0	.41	.33	.27	.41	.33	.27	.40	.32	.27	.39	.32	.27	.38	.31	.27	.25
10.0	.38	.30	.25	.38	.30	.25	.37	.30	.25	.36	.29	.24	.35	.29	.24	.23

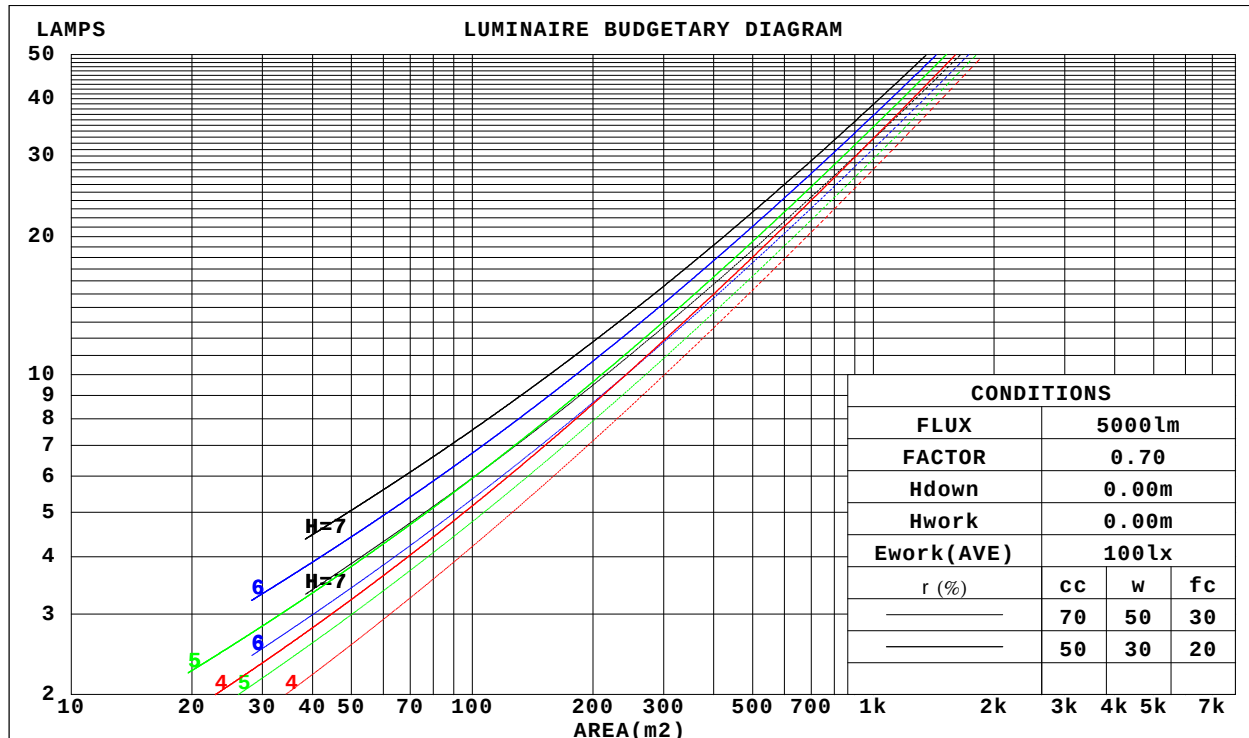

C Range: 0 - 360DEG
 C Interval: 90.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:
 Test Date:13 March 2024

g Range: 0 - 90DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:8.300m [K=1.0723]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

WEC AND CCEC

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm					
NAME:			TYPE:		WEIGHT:
SPEC.:100-277v			DIM.:		SERIAL No.:
MFR.:			SUR.:		Shielding Angle:

r CC	80%			70%			50%			30%			10%			0
r W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r fc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Wall Exitance Coefficients(WEC)															
0.0																
1.0	.330	.188	.060	.323	.184	.059	.310	.178	.057	.297	.172	.055	.286	.166	.053	
2.0	.306	.168	.051	.299	.165	.051	.288	.160	.050	.277	.155	.049	.267	.151	.048	
3.0	.280	.149	.045	.275	.147	.044	.264	.143	.044	.255	.140	.043	.246	.136	.042	
4.0	.257	.134	.039	.252	.132	.039	.243	.129	.038	.234	.126	.038	.226	.123	.037	
5.0	.237	.121	.035	.232	.119	.035	.224	.117	.034	.216	.114	.034	.209	.112	.034	
6.0	.219	.110	.031	.215	.109	.031	.208	.106	.031	.201	.104	.031	.194	.102	.030	
7.0	.203	.100	.028	.200	.099	.028	.193	.098	.028	.187	.096	.028	.181	.094	.028	
8.0	.189	.092	.026	.186	.092	.026	.180	.090	.026	.175	.089	.026	.170	.087	.025	
9.0	.177	.086	.024	.174	.085	.024	.169	.084	.024	.164	.082	.024	.159	.081	.023	
10.0	.166	.080	.022	.164	.079	.022	.159	.078	.022	.155	.077	.022	.150	.076	.022	

r c c	80%			70%			50%			30%			10%			0
r w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r f c	20%			20%			20%			20%			20%			0
R C R	R C R:Room Cavity Ratio Ceiling Cavity Exitance Coefficients(C C E C)															
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.182	.156	.133	.155	.134	.114	.106	.092	.079	.061	.053	.046	.020	.017	.015	
2.0	.174	.132	.096	.149	.113	.083	.102	.079	.058	.059	.046	.034	.019	.015	.011	
3.0	.166	.114	.073	.143	.099	.063	.098	.069	.044	.057	.040	.026	.018	.013	.009	
4.0	.159	.101	.057	.136	.087	.050	.094	.061	.035	.054	.036	.021	.017	.012	.007	
5.0	.151	.091	.046	.130	.079	.040	.090	.055	.028	.052	.032	.017	.017	.011	.006	
6.0	.144	.083	.038	.124	.071	.033	.085	.050	.024	.050	.029	.014	.016	.010	.005	
7.0	.137	.076	.033	.118	.066	.028	.081	.046	.020	.047	.027	.012	.015	.009	.004	
8.0	.130	.070	.028	.112	.061	.025	.078	.043	.017	.045	.025	.010	.015	.008	.003	
9.0	.124	.065	.025	.107	.056	.022	.074	.040	.015	.043	.023	.009	.014	.008	.003	
10.0	.118	.061	.022	.102	.053	.019	.071	.037	.014	.041	.022	.008	.013	.007	.003	

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

UGR(Unified Glare Rating) Table

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm											
NAME:					TYPE:			WEIGHT:			
SPEC.:100-277v					DIM.:			SERIAL No.:			
MFR.:					SUR.:			Shielding Angle:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	20.3	21.9	20.6	22.1	22.3	20.6	22.2	20.9	22.4	22.6	
	3H	21.9	23.3	22.2	23.6	23.8	22.3	23.8	22.6	24.0	24.3
	4H	22.5	23.9	22.8	24.2	24.4	23.1	24.5	23.4	24.7	25.0
	6H	23.0	24.3	23.3	24.6	24.9	23.7	25.0	24.0	25.2	25.5
	8H	23.1	24.4	23.5	24.7	25.0	23.9	25.1	24.2	25.4	25.7
	12H	23.2	24.5	23.6	24.7	25.1	24.1	25.3	24.4	25.6	25.9
4H	2H	21.0	22.4	21.3	22.6	22.9	21.2	22.6	21.6	22.9	23.1
	3H	22.8	24.0	23.1	24.3	24.6	23.1	24.4	23.5	24.7	25.0
	4H	23.5	24.6	23.9	25.0	25.3	24.0	25.1	24.4	25.4	25.8
	6H	24.1	25.1	24.5	25.5	25.8	24.7	25.7	25.1	26.1	26.4
	8H	24.3	25.3	24.8	25.6	26.0	25.0	26.0	25.4	26.3	26.7
	12H	24.5	25.3	24.9	25.7	26.1	25.3	26.1	25.7	26.5	26.9
8H	4H	23.9	24.8	24.3	25.2	25.6	24.3	25.2	24.7	25.6	26.0
	6H	24.6	25.4	25.1	25.8	26.3	25.2	26.0	25.6	26.4	26.8
	8H	25.0	25.6	25.4	26.1	26.5	25.6	26.3	26.0	26.7	27.2
	12H	25.2	25.8	25.7	26.2	26.7	25.9	26.5	26.4	27.0	27.5
12H	4H	23.9	24.8	24.3	25.1	25.6	24.3	25.2	24.7	25.5	25.9
	6H	24.7	25.4	25.2	25.9	26.3	25.3	25.9	25.7	26.4	26.8
	8H	25.1	25.7	25.6	26.1	26.6	25.7	26.3	26.2	26.7	27.2
Variations with the observer position at spacings:											
S = 1.0H	+ 0.1 / - 0.2					+ 0.1 / - 0.2					
1.5H	+ 0.2 / - 0.3					+ 0.2 / - 0.3					
2.0H	+ 0.2 / - 0.4					+ 0.1 / - 0.3					

CIE Pub.117, 2896 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 3.7$)

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

UTILIZATION FACTORS TABLE

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	56	44	37	55	44	37	54	43	37	30
0.80	66	54	46	65	53	46	63	53	46	39
1.00	74	63	55	73	62	55	71	64	54	47
1.25	81	70	63	80	70	63	77	68	62	54
1.50	86	76	69	85	75	68	82	73	67	59
2.00	94	85	78	92	83	77	88	81	75	67
2.50	98	89	83	96	88	82	92	85	80	72
3.00	101	94	88	99	92	87	95	89	85	76
4.00	105	99	94	103	97	93	99	94	90	81
5.00	108	103	98	105	101	97	101	97	94	84
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		


C Range: 0 - 360DEG
 C Interval: 90.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:
 Test Date:13 March 2024

g Range: 0 - 90DEG
 g Interval: 1.0DEG
 Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:8.300m [K=1.0723]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ISOCANDELA DIAGRAM

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

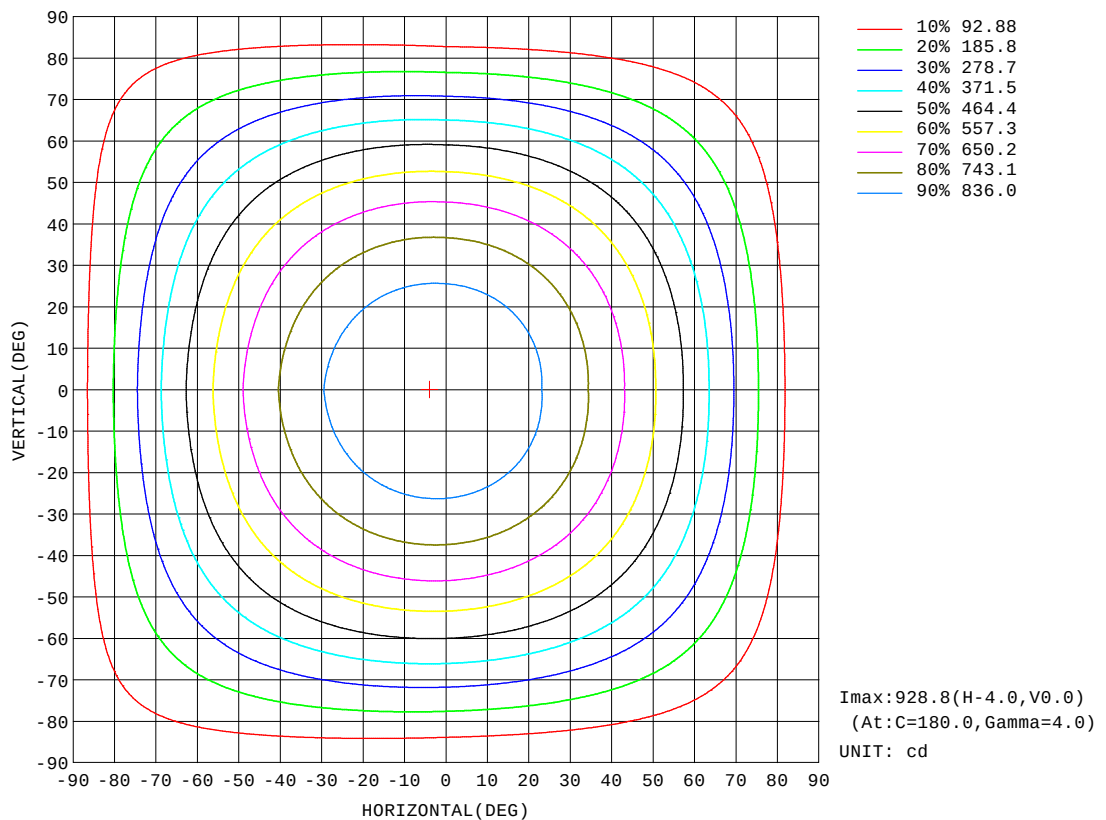


C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

AAI Figure

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

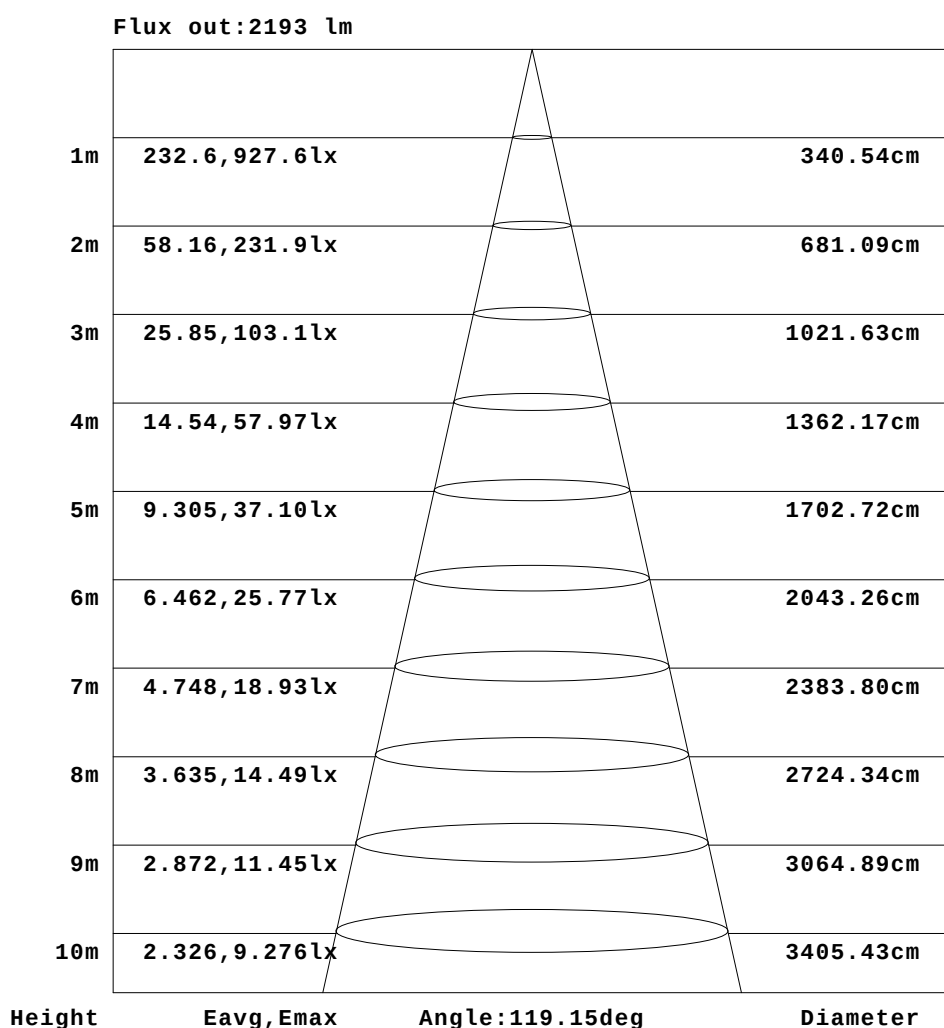

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.


C Range: 0 - 360DEG
 C Interval: 90.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:
 Test Date:13 March 2024

g Range: 0 - 90DEG
 g Interval: 1.0DEG
 Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:8.300m [K=1.0723]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ISOLUX DIAGRAM

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

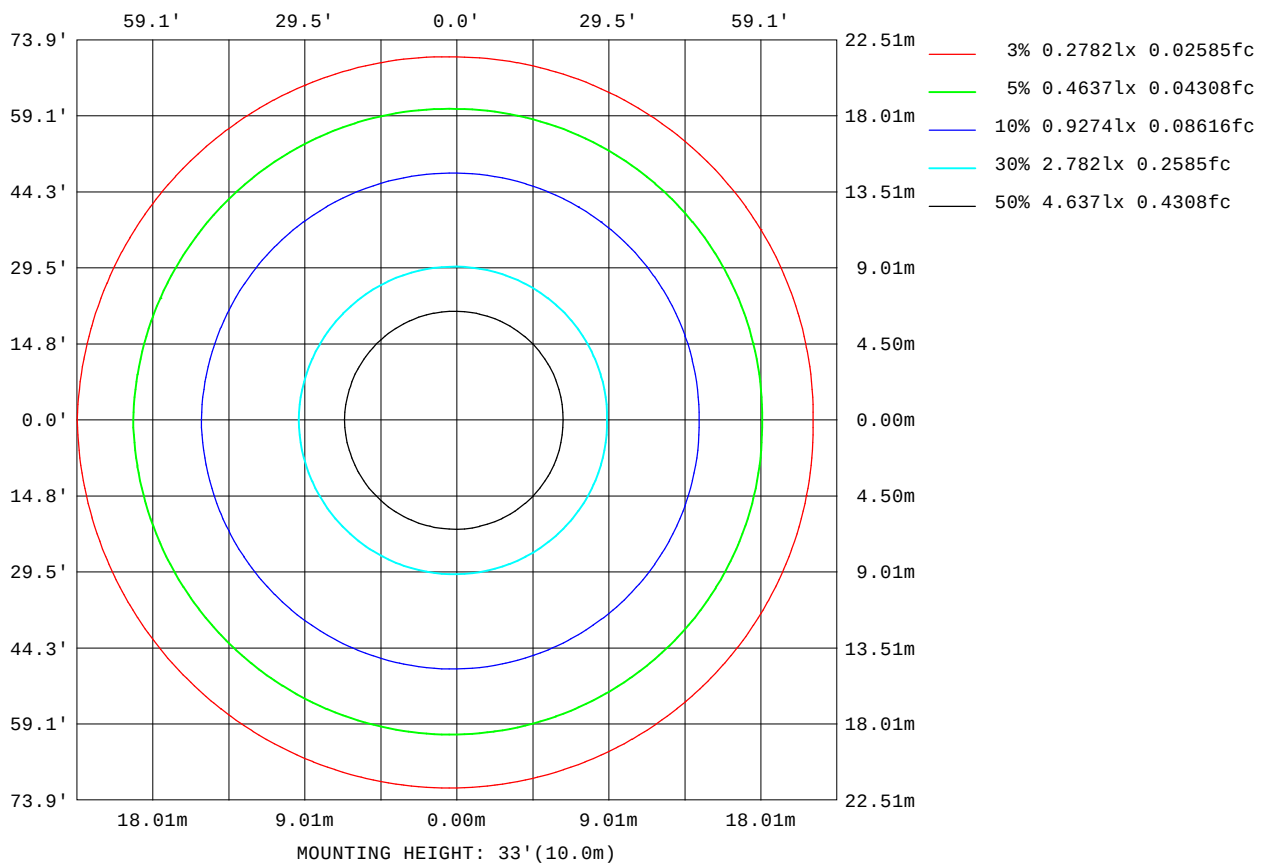

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LED Avg.L Report

Test:U:120.34V I:0.1649A P:19.505W PF:0.9828 Freq:59.98Hz Lamp Flux:2896.21x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	9215
L_0~180(75)av	8939
L_0~180(85)av	9527
L_90~270(65)av	8997
L_90~270(75)av	8439
L_90~270(85)av	8093
L_45(65)av	9139
L_45(75)av	8720
L_45(85)av	8857

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

Planar Illuminance Curve

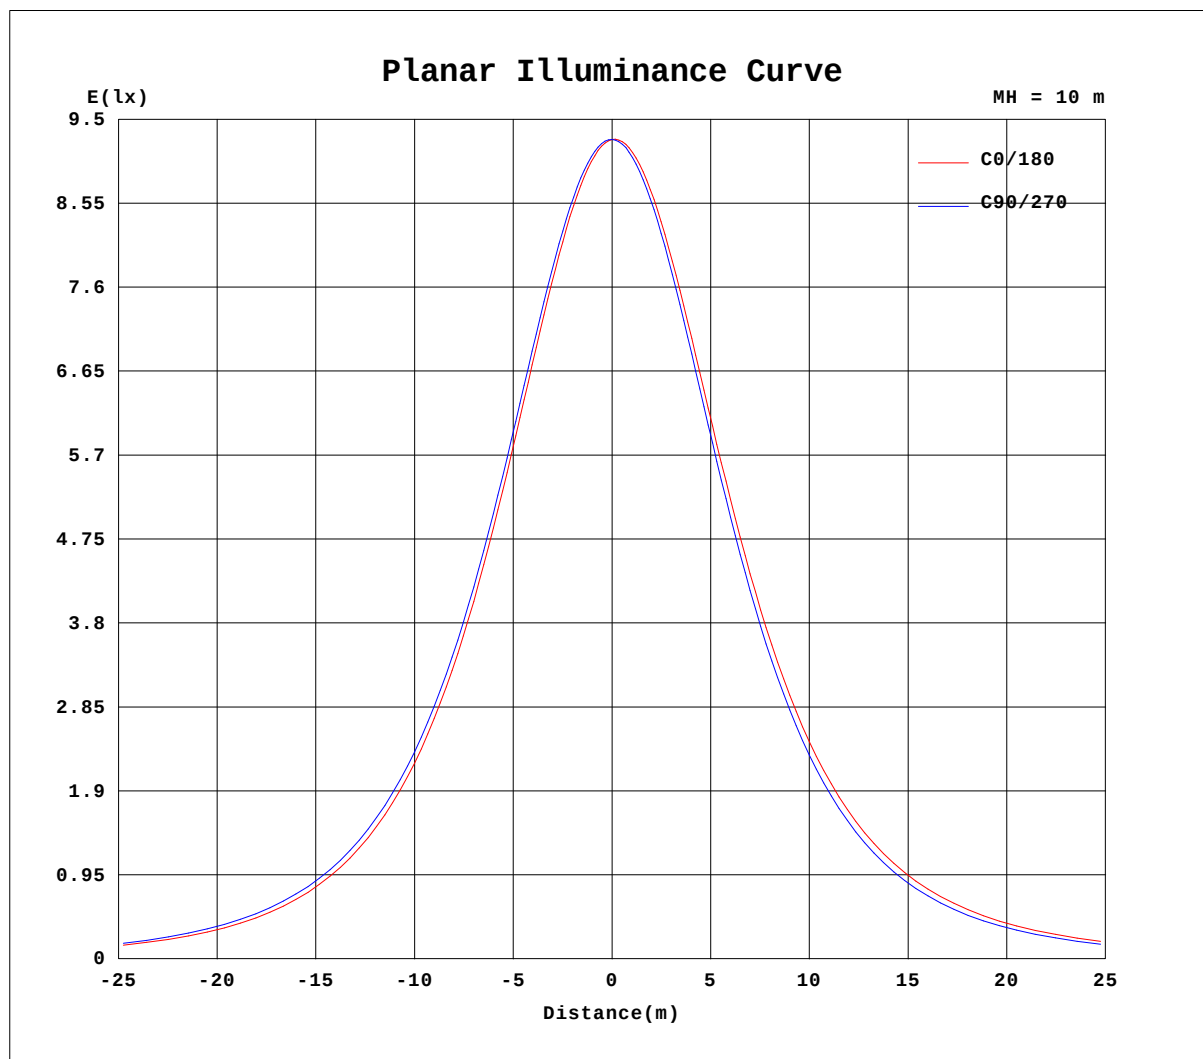

C Range: 0 - 360DEG
 C Interval: 90.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators:
 Test Date: 13 March 2024

g Range: 0 - 90DEG
 g Interval: 1.0DEG
 Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.400
 Humidity: 65.0%
 Test Distance: 8.300m [K=1.0723]
 Remarks:

UNIT: cd

```

Range: 0 - 90DEG
Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

```


EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

Photometric Data Table [cd]

G/C	0.0	90.0	180.0	270.0
0.0	927.4	927.3	927.4	927.3
3.0	923.5	926.6	928.8	925.7
6.0	917.2	923.0	927.8	921.7
9.0	908.5	917.2	924.4	915.2
12.0	897.8	908.6	918.4	906.1
15.0	884.0	898.0	910.0	895.2
18.0	868.2	884.6	899.4	881.1
21.0	850.6	869.0	886.2	865.0
24.0	830.0	851.3	870.6	846.1
27.0	807.4	830.8	852.5	825.5
30.0	782.7	808.3	832.5	801.9
33.0	756.5	783.8	809.4	776.7
36.0	727.1	756.6	784.7	748.8
39.0	695.8	727.7	757.2	718.6
42.0	663.4	696.7	727.5	686.9
45.0	627.8	663.1	695.9	652.7
48.0	590.6	627.7	661.5	616.1
51.0	552.0	590.1	625.7	577.9
54.0	511.4	550.3	587.2	537.1
57.0	468.5	508.5	546.5	493.9
60.0	424.8	465.3	504.3	449.7
63.0	379.2	420.0	460.4	403.2
66.0	332.5	373.3	414.5	355.6
69.0	286.2	324.3	367.2	307.2
72.0	238.9	275.6	318.6	258.2
75.0	192.5	227.2	270.2	209.6
78.0	147.0	180.2	222.3	161.7
81.0	104.1	134.5	174.9	116.9
84.0	64.04	91.71	129.3	75.39
87.0	27.95	53.39	86.36	38.52
90.0	0	19.23	45.67	7.975


C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

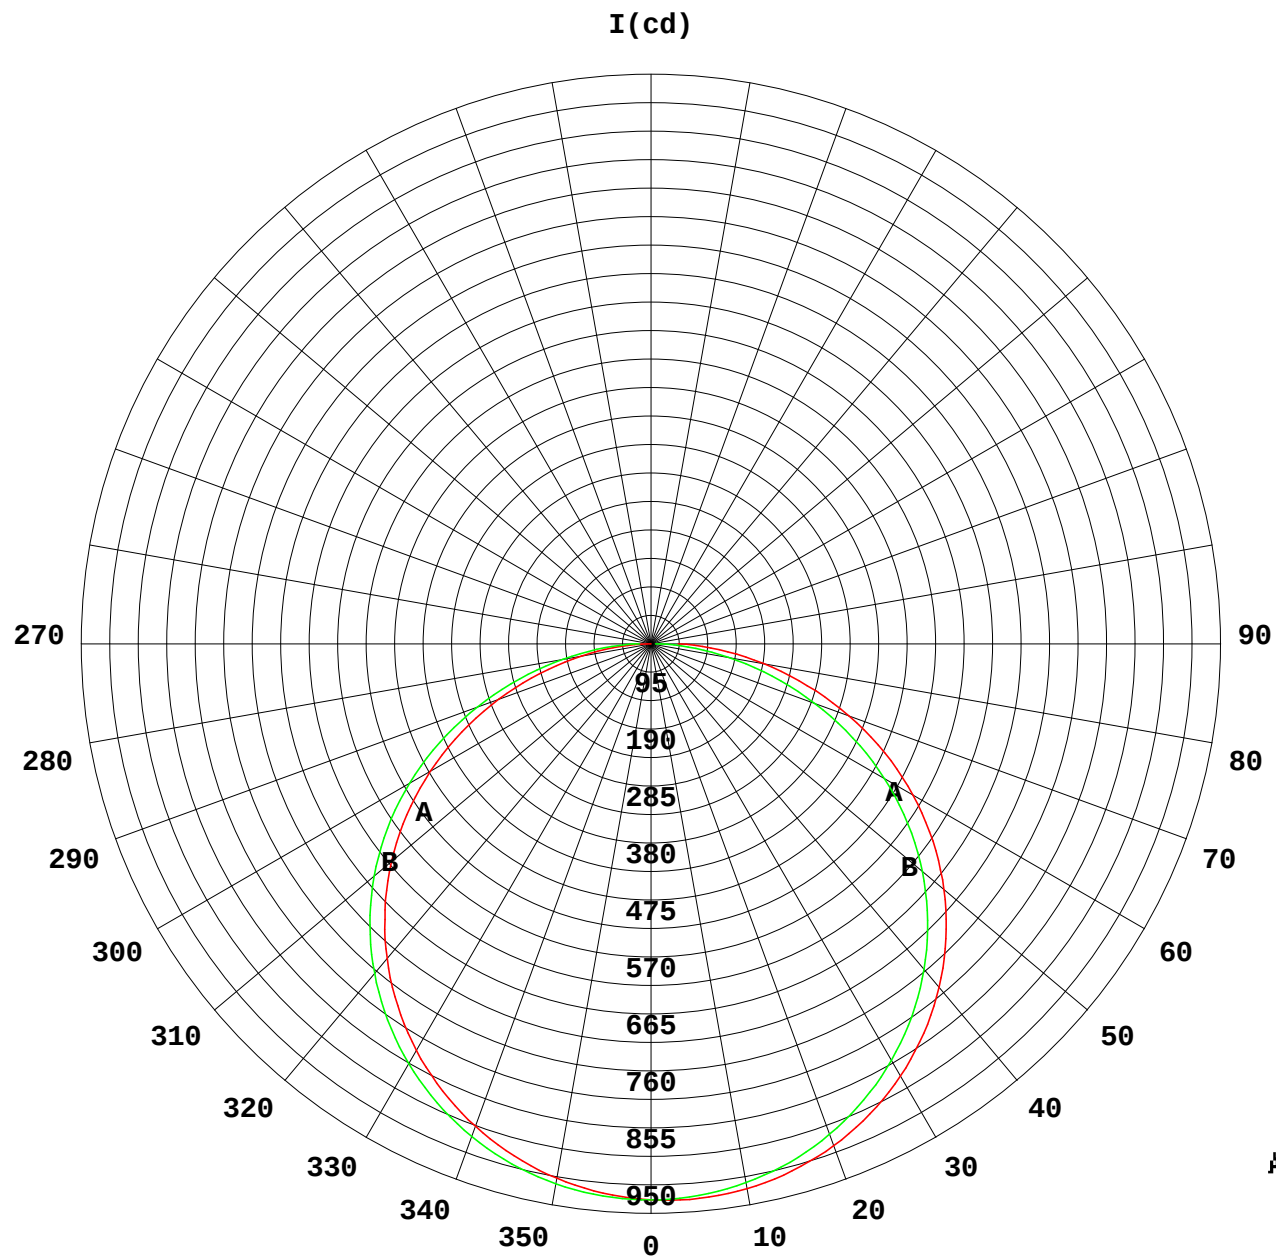

1000 lm

K = 1

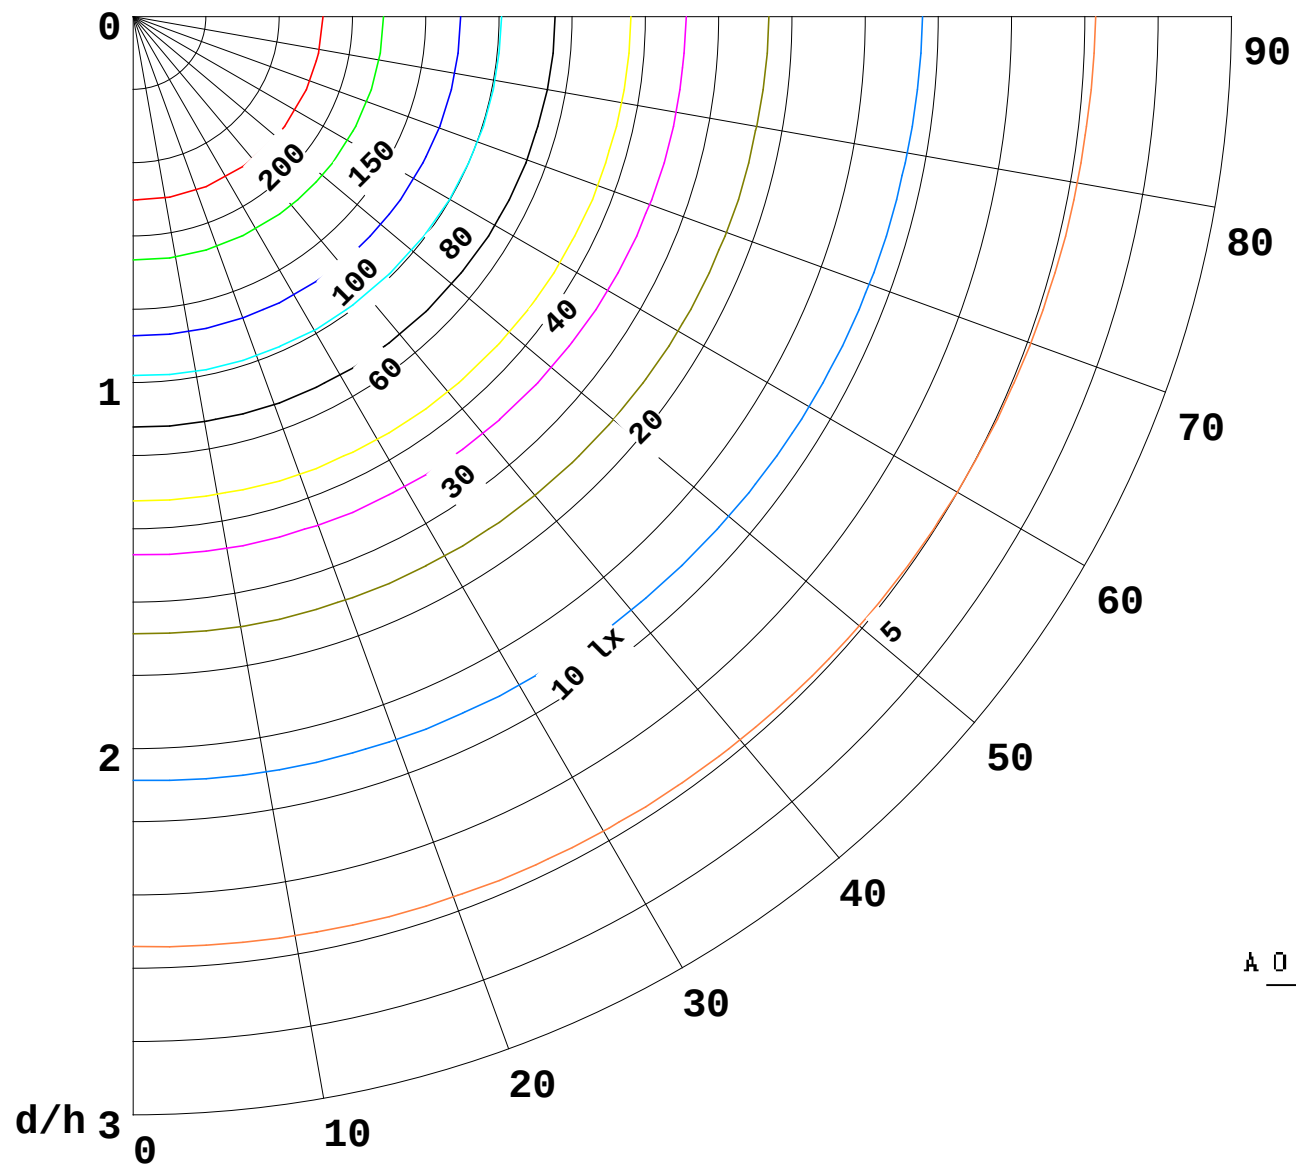

F

=

5000 lm

K

=

0.7

Hcc

=

0.0 m

Hfc

=

0.0 m

Eave

=

100 lx

Pcc

70

Pw

50

Pfc

30

Pcc

50

Pw

30

Pfc

20

