


EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 131.54 lm/W			
MODEL		I _{max} (cd)	1628	S/MH(C0/180)	1.33
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	1.29
RATED VOLTAGE(V)	120-277	TOTAL FLUX(lm)	5083.0	h UP, DN(C0-180)	0.0,48.6
NOMINAL FLUX(lm)	5083.04	CIE CLASS	DIRECT	h UP, DN(C180-360)	0.0,51.4
LAMPS INSIDE	1	h up(%)	0.0	CIBSE SHR NOM	1.50
TEST VOLTAGE(V)	120	h down(%)	100.0	CIBSE SHR MAX	1.50

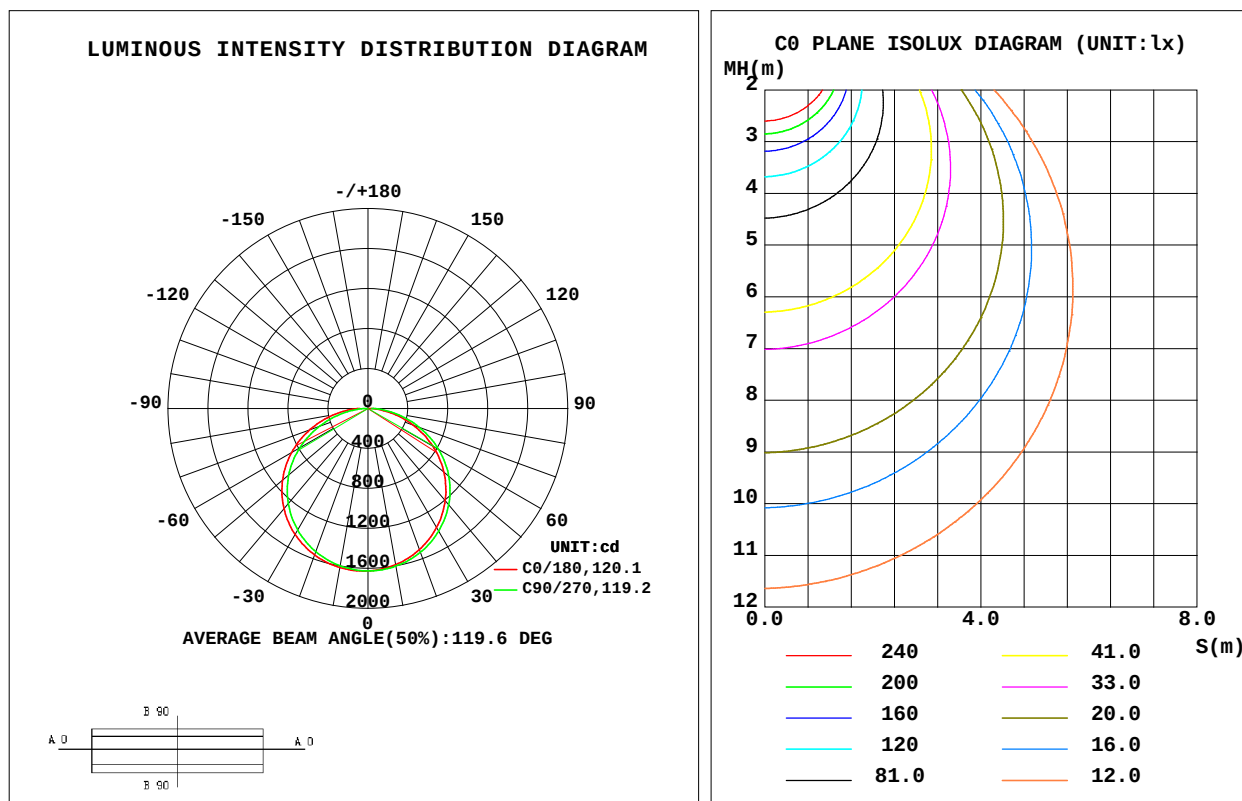

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:13 March 2024

α Range: 0 - 90DEG
α Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

g	C0	C90	C180	C270					g	F zone	F total	%lum, lamp
10	1587	1602	1616	1599					0- 10	154.0	154.0	3.03, 3.03
20	1503	1532	1560	1525					10- 20	443.8	597.8	11.8, 11.8
30	1374	1416	1457	1405					20- 30	681.2	1279	25.2, 25.2
40	1203	1257	1308	1242					30- 40	837.6	2117	41.6, 41.6
50	991.2	1057	1117	1037					40- 50	892.2	3009	59.2, 59.2
60	747.2	816.3	882.9	788.8					50- 60	834.5	3843	75.6, 75.6
70	475.9	543.0	616.6	511.0					60- 70	667.4	4511	88.7, 88.7
80	210.3	263.9	335.0	233.0					70- 80	419.3	4930	97, 97
90	2.161	36.68	82.60	16.53					80- 90	153.0	5083	100, 100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		


C Range: 0 - 360DEG
 C Interval: 90.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:
 Test Date:13 March 2024

g Range: 0 - 90DEG
 g Interval: 1.0DEG
 Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:8.300m [K=1.0723]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINANCE LIMITATION CURVES

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

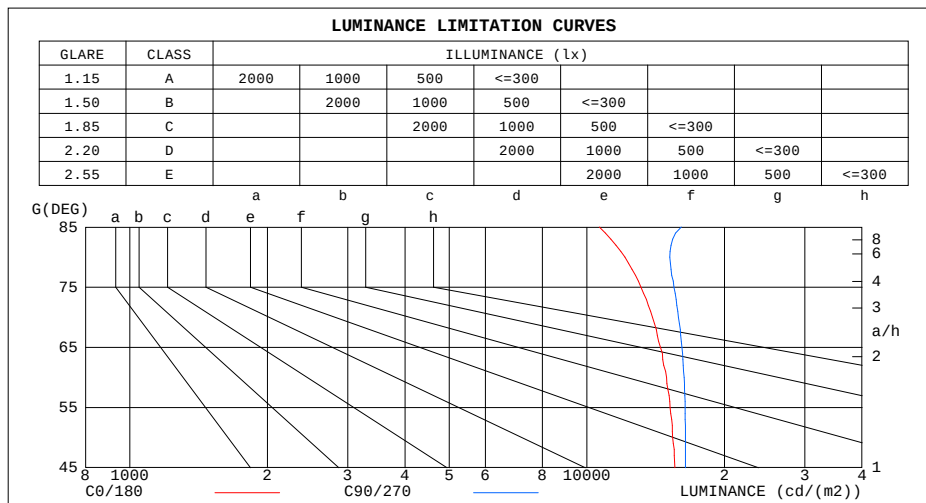

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	10653	16098
80	12113	15200
75	13133	15521
70	13913	15875
65	14501	16149
60	14943	16326
55	15218	16408
50	15421	16442
45	15589	16440

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024


g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

r cc	80%			70%			50%			30%			10%			0
r w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r fc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.03	.98	.94	1.00	.96	.92	.96	.93	.90	.92	.89	.87	.89	.86	.84	.82
2.0	.89	.82	.76	.87	.80	.75	.83	.78	.73	.80	.75	.71	.77	.73	.70	.67
3.0	.78	.69	.62	.76	.68	.62	.73	.66	.61	.70	.64	.60	.68	.63	.58	.56
4.0	.69	.59	.52	.67	.59	.52	.65	.57	.51	.62	.56	.51	.60	.54	.50	.48
5.0	.61	.52	.45	.60	.51	.45	.58	.50	.44	.56	.49	.44	.54	.48	.43	.41
6.0	.55	.46	.39	.54	.45	.39	.52	.44	.38	.50	.43	.38	.49	.43	.38	.36
7.0	.50	.41	.34	.49	.40	.34	.47	.39	.34	.46	.39	.34	.44	.38	.33	.31
8.0	.45	.36	.30	.44	.36	.30	.43	.36	.30	.42	.35	.30	.41	.34	.30	.28
9.0	.41	.33	.27	.41	.33	.27	.40	.32	.27	.39	.32	.27	.38	.31	.27	.25
10.0	.38	.30	.25	.38	.30	.25	.37	.29	.25	.36	.29	.24	.35	.29	.24	.23

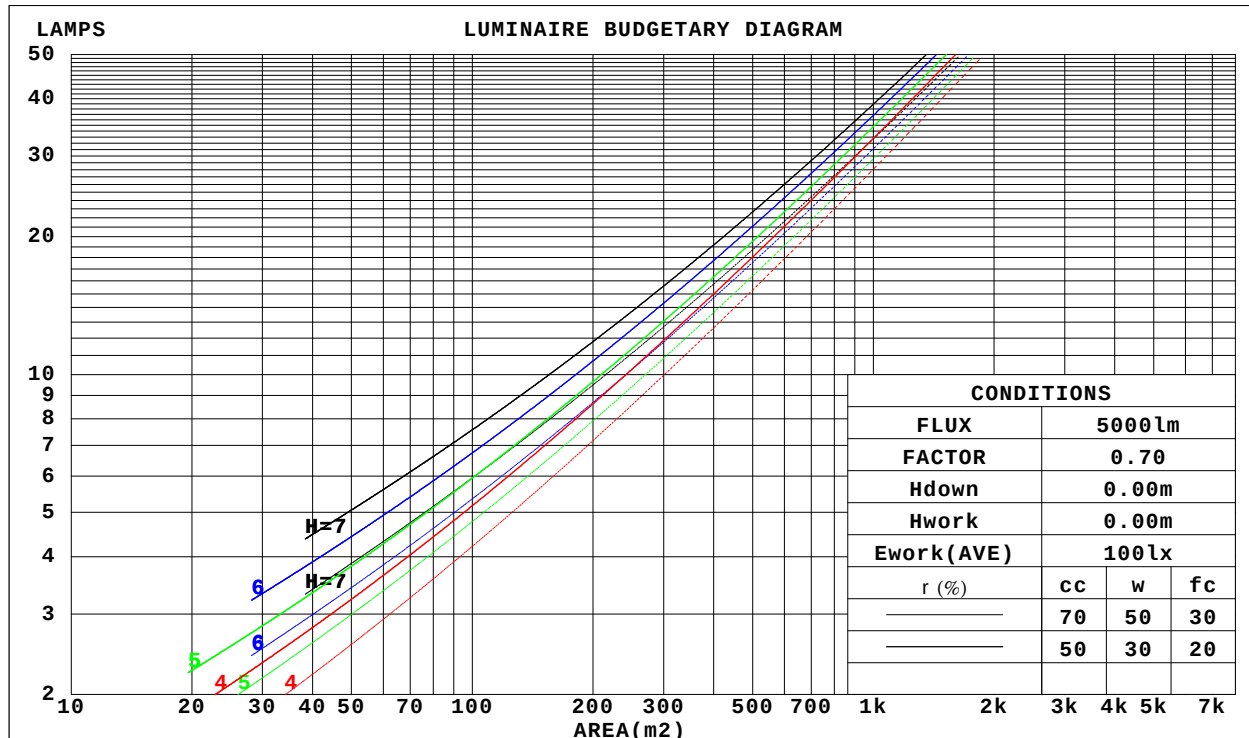

C Range: 0 - 360DEG
 C Interval: 90.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:
 Test Date:13 March 2024

g Range: 0 - 90DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:8.300m [K=1.0723]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

WEC AND CCEC

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:100-277v		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

r CC	80%			70%			50%			30%			10%			0
r W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r fc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Wall Exitance Coefficients(WEC)															
0.0																
1.0	.331	.188	.060	.324	.185	.059	.310	.178	.057	.298	.172	.055	.287	.166	.054	
2.0	.306	.168	.051	.300	.165	.051	.288	.160	.050	.277	.155	.049	.267	.151	.048	
3.0	.281	.149	.045	.275	.147	.044	.265	.143	.044	.255	.140	.043	.246	.136	.042	
4.0	.257	.134	.039	.253	.132	.039	.243	.129	.039	.235	.126	.038	.227	.123	.037	
5.0	.237	.121	.035	.233	.119	.035	.224	.117	.034	.217	.114	.034	.209	.112	.034	
6.0	.219	.110	.031	.215	.109	.031	.208	.106	.031	.201	.104	.031	.194	.102	.030	
7.0	.203	.100	.028	.200	.100	.028	.193	.098	.028	.187	.096	.028	.181	.094	.028	
8.0	.189	.093	.026	.186	.092	.026	.180	.090	.026	.175	.089	.026	.170	.087	.025	
9.0	.177	.086	.024	.174	.085	.024	.169	.084	.024	.164	.082	.024	.159	.081	.023	
10.0	.166	.080	.022	.164	.079	.022	.159	.078	.022	.155	.077	.022	.150	.076	.022	

r c c	80%			70%			50%			30%			10%			0
r w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r f c	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Ceiling Cavity Exitance Coefficients(CCEC)															
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.182	.156	.133	.156	.134	.114	.106	.092	.079	.061	.053	.046	.020	.017	.015	
2.0	.174	.132	.096	.149	.113	.083	.102	.079	.058	.059	.046	.034	.019	.015	.011	
3.0	.167	.114	.073	.143	.099	.063	.098	.069	.044	.057	.040	.026	.018	.013	.009	
4.0	.159	.101	.057	.136	.087	.050	.094	.061	.035	.054	.036	.021	.017	.012	.007	
5.0	.151	.091	.046	.130	.079	.040	.090	.055	.028	.052	.032	.017	.017	.011	.006	
6.0	.144	.083	.038	.124	.071	.033	.085	.050	.024	.050	.029	.014	.016	.010	.005	
7.0	.137	.076	.033	.118	.066	.028	.081	.046	.020	.047	.027	.012	.015	.009	.004	
8.0	.130	.070	.028	.112	.061	.025	.078	.043	.017	.045	.025	.010	.015	.008	.003	
9.0	.124	.065	.025	.107	.056	.022	.074	.040	.015	.043	.023	.009	.014	.008	.003	
10.0	.118	.061	.022	.102	.053	.019	.071	.037	.014	.041	.022	.008	.013	.007	.003	

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

UGR(Unified Glare Rating) Table

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm											
NAME:					TYPE:			WEIGHT:			
SPEC.:100-277v					DIM.:			SERIAL No.:			
MFR.:					SUR.:			Shielding Angle:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	2H	22.3	23.8	22.5	24.0	24.2	22.6	24.1	22.9	24.4	24.6
	3H	23.8	25.3	24.1	25.5	25.8	24.3	25.8	24.6	26.0	26.2
	4H	24.5	25.9	24.8	26.1	26.4	25.0	26.4	25.4	26.7	26.9
	6H	25.0	26.3	25.3	26.6	26.8	25.6	26.9	26.0	27.2	27.5
	8H	25.1	26.4	25.5	26.7	27.0	25.9	27.1	26.2	27.4	27.7
	12H	25.2	26.4	25.6	26.7	27.0	26.0	27.3	26.4	27.6	27.9
4H	2H	23.0	24.3	23.3	24.6	24.8	23.2	24.6	23.5	24.8	25.1
	3H	24.7	25.9	25.1	26.2	26.6	25.1	26.3	25.5	26.6	26.9
	4H	25.5	26.6	25.9	26.9	27.3	26.0	27.1	26.4	27.4	27.8
	6H	26.1	27.1	26.5	27.5	27.8	26.7	27.7	27.1	28.1	28.4
	8H	26.3	27.3	26.8	27.6	28.0	27.0	27.9	27.4	28.3	28.7
	12H	26.5	27.3	26.9	27.7	28.1	27.3	28.1	27.7	28.5	28.9
8H	4H	25.9	26.8	26.3	27.1	27.5	26.3	27.2	26.7	27.6	27.9
	6H	26.6	27.4	27.1	27.8	28.2	27.2	27.9	27.6	28.4	28.8
	8H	27.0	27.6	27.4	28.1	28.5	27.6	28.3	28.0	28.7	29.1
	12H	27.2	27.8	27.7	28.2	28.7	27.9	28.5	28.4	29.0	29.5
12H	4H	25.9	26.7	26.3	27.1	27.5	26.3	27.1	26.7	27.5	27.9
	6H	26.7	27.4	27.2	27.8	28.3	27.2	27.9	27.7	28.4	28.8
	8H	27.1	27.7	27.6	28.1	28.6	27.7	28.3	28.2	28.7	29.2
Variations with the observer position at spacings:											
S = 1.0H		+ 0.1 / - 0.2					+ 0.1 / - 0.2				
1.5H		+ 0.2 / - 0.3					+ 0.2 / - 0.3				
2.0H		+ 0.1 / - 0.4					+ 0.1 / - 0.3				

CIE Pub.117, 5083 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 5.6$)

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

UTILIZATION FACTORS TABLE

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	56	44	37	55	44	37	54	43	37	30
0.80	66	54	46	65	53	46	63	53	46	39
1.00	74	63	55	73	62	55	71	64	54	47
1.25	81	70	63	80	70	63	77	68	62	54
1.50	86	76	69	85	75	68	82	73	67	59
2.00	94	84	78	92	83	77	88	81	75	67
2.50	98	89	83	95	88	82	92	85	80	72
3.00	101	94	88	99	92	87	95	89	85	76
4.00	105	99	94	103	97	93	99	94	90	81
5.00	108	103	98	105	101	97	101	97	94	84
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		


C Range: 0 - 360DEG
 C Interval: 90.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:
 Test Date:13 March 2024

g Range: 0 - 90DEG
 g Interval: 1.0DEG
 Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:8.300m [K=1.0723]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ISOCANDELA DIAGRAM

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

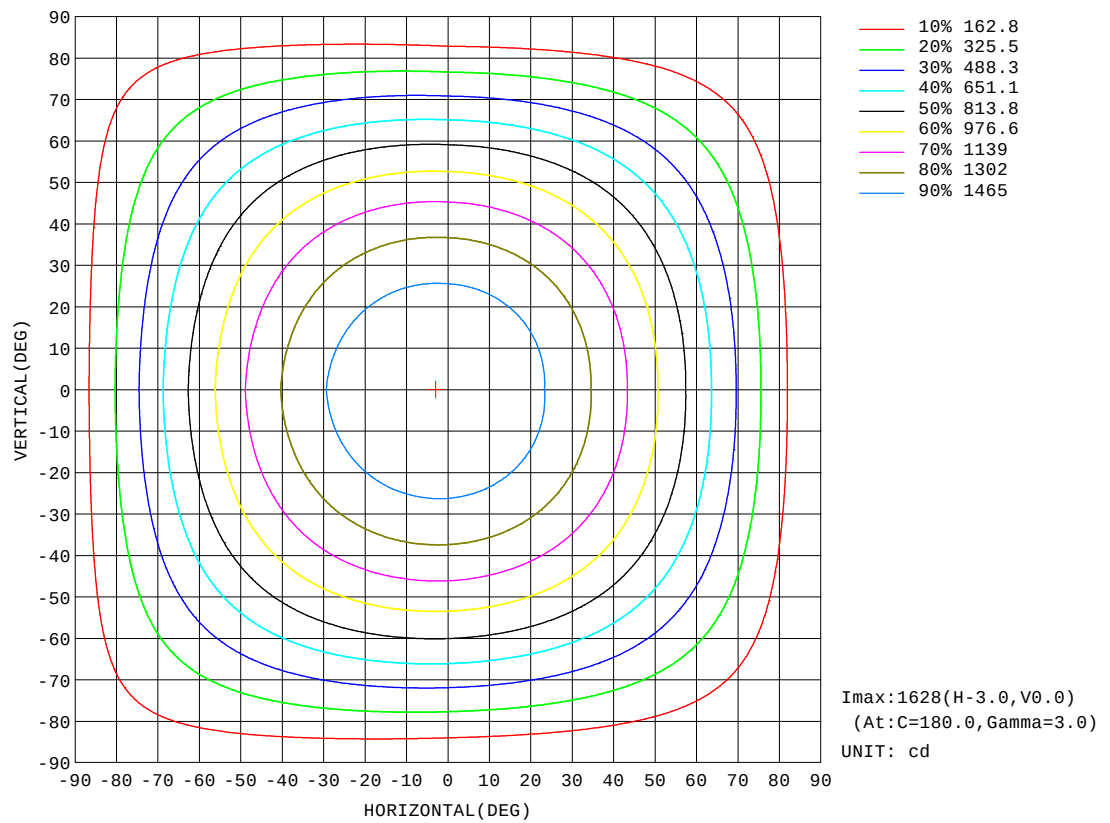

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:13 March 2024


g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

AAI Figure

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

Flux out:3843 lm

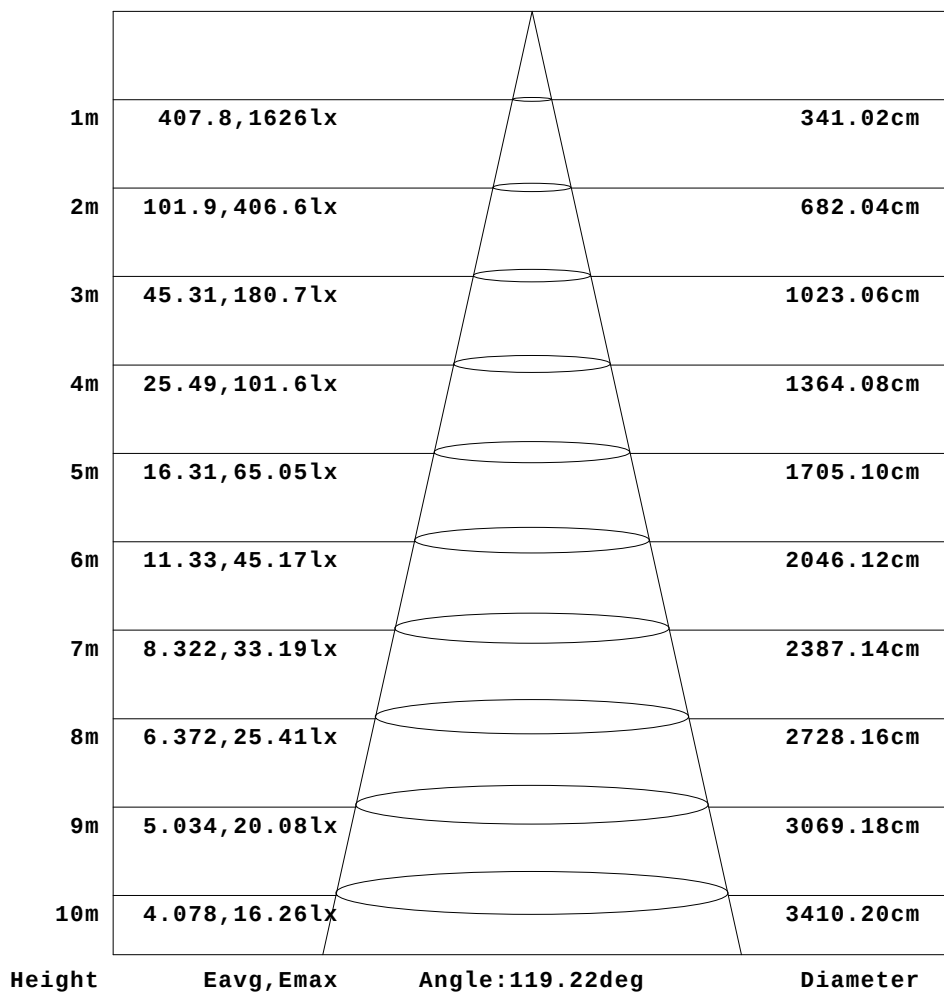

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.


C Range: 0 - 360DEG
 C Interval: 90.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:
 Test Date:13 March 2024

g Range: 0 - 90DEG
 g Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
 Humidity:65.0%
 Test Distance:8.300m [K=1.0723]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ISOLUX DIAGRAM

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

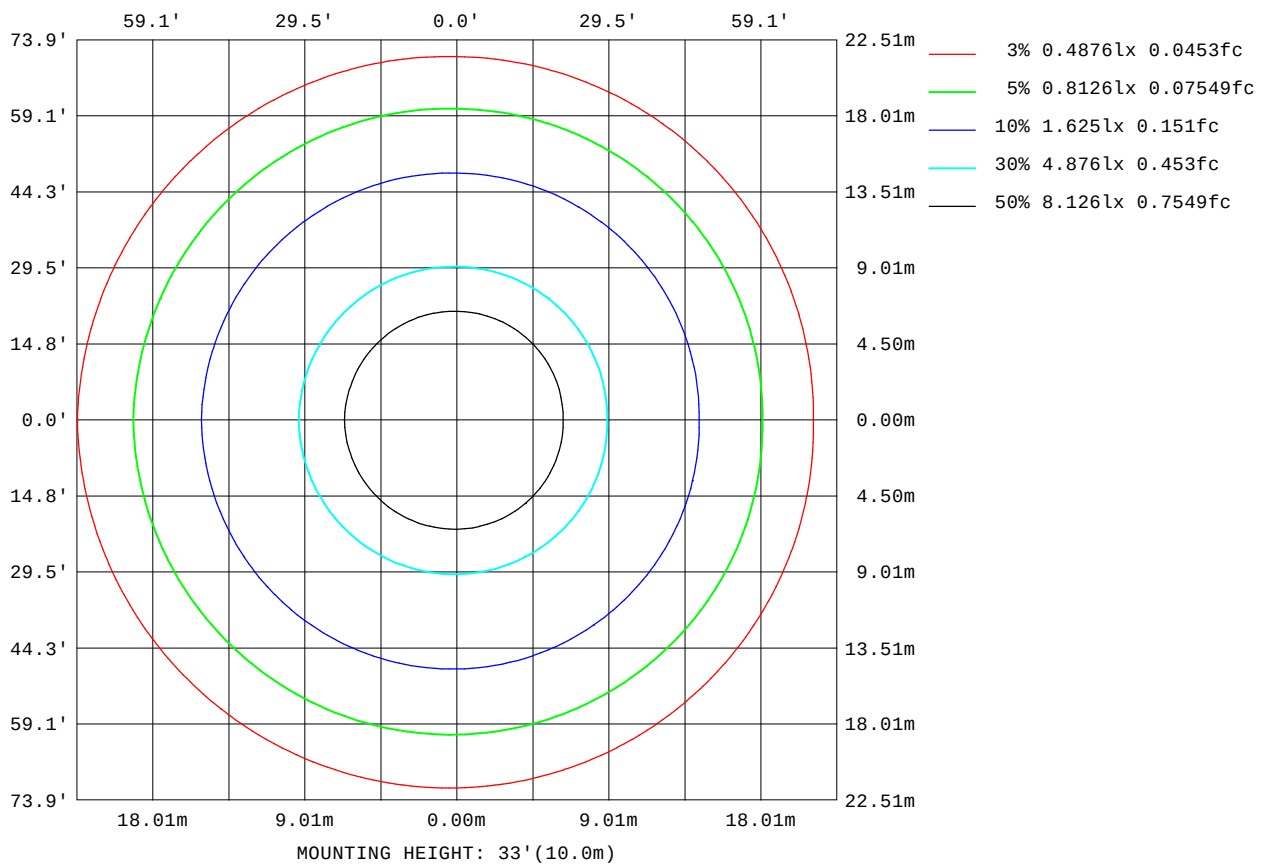

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LED Avg.L Report

Test:U:120.32V I:0.3227A P:38.642W PF:0.9954 Freq:59.98Hz Lamp Flux:5083.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:100-277v	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	16164
L_0~180(75)av	15755
L_0~180(85)av	16955
L_90~270(65)av	15790
L_90~270(75)av	14879
L_90~270(85)av	14470
L_45(65)av	16034
L_45(75)av	15372
L_45(85)av	15795

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

Planar Illuminance Curve

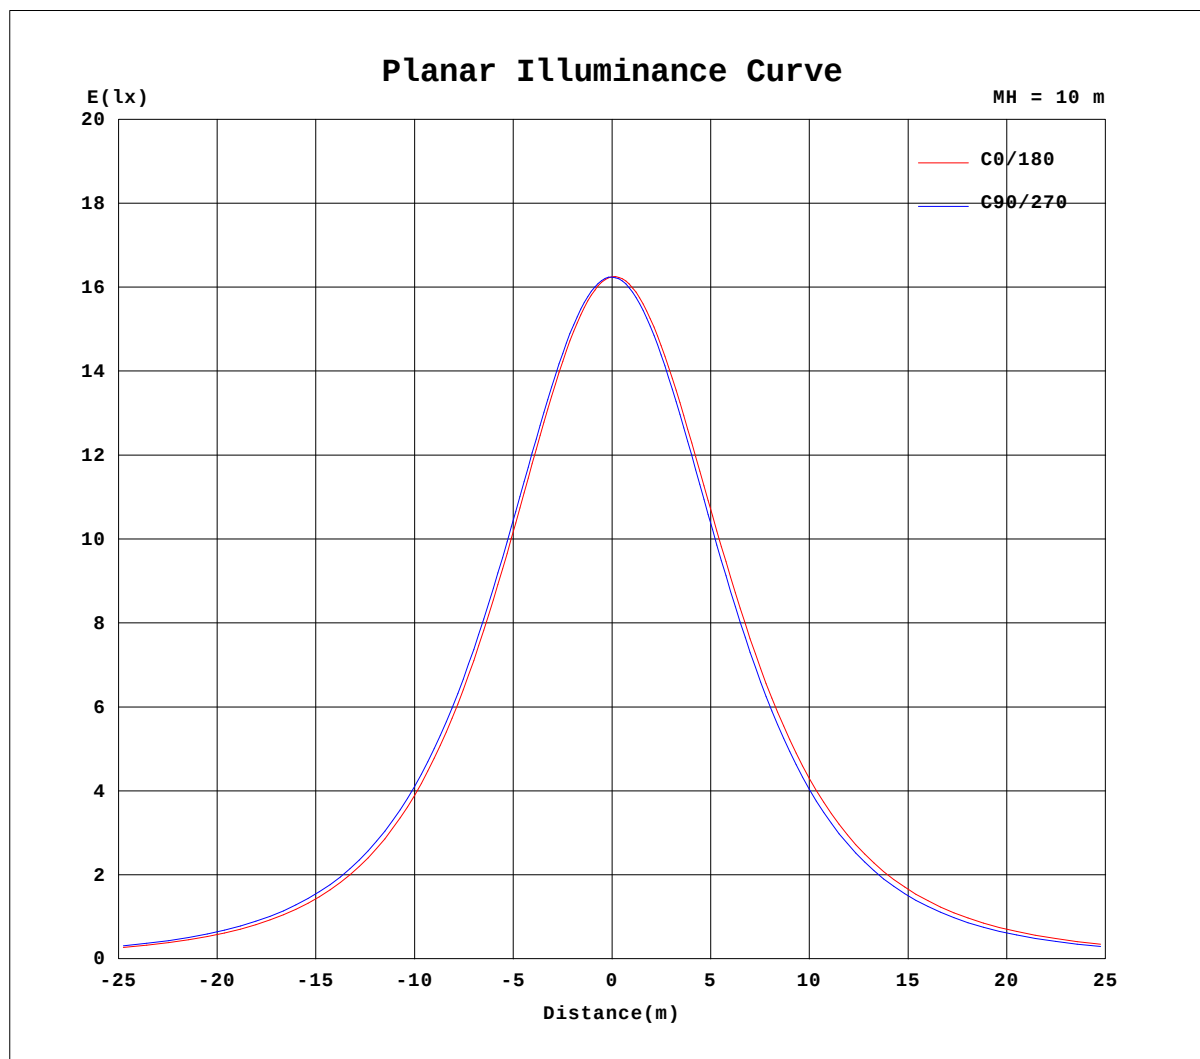

C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

UNIT: cd

```

Range: 0 - 90DEG
Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.400
Humidity:65.0%
Test Distance:8.300m [K=1.0723]
Remarks:

```


EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

Photometric Data Table [cd]

G/C	0.0	90.0	180.0	270.0
0.0	1625	1625	1625	1625
3.0	1619	1623	1628	1622
6.0	1608	1617	1625	1615
9.0	1593	1607	1620	1604
12.0	1574	1592	1609	1588
15.0	1551	1573	1594	1568
18.0	1523	1550	1575	1544
21.0	1492	1522	1552	1515
24.0	1457	1491	1525	1483
27.0	1417	1456	1493	1446
30.0	1374	1416	1457	1405
33.0	1328	1373	1417	1361
36.0	1276	1326	1374	1313
39.0	1222	1275	1325	1260
42.0	1165	1221	1274	1204
45.0	1102	1162	1218	1144
48.0	1039	1100	1158	1080
51.0	968.9	1035	1095	1014
54.0	897.5	964.9	1028	942.3
57.0	824.4	892.2	956.7	866.6
60.0	747.2	816.3	882.9	788.8
63.0	665.4	737.2	805.7	707.6
66.0	583.8	654.7	725.8	624.2
69.0	503.6	571.6	644.3	539.5
72.0	421.3	486.5	560.5	453.8
75.0	339.9	401.7	475.6	368.5
78.0	261.2	318.0	392.3	286.4
81.0	185.7	238.2	307.9	207.8
84.0	114.8	163.5	228.2	134.4
87.0	51.62	96.32	153.4	69.98
90.0	2.161	36.68	82.60	16.53



C Range: 0 - 360DEG
C Interval: 90.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 13 March 2024

g Range: 0 - 90DEG
g Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.400
Humidity: 65.0%
Test Distance: 8.300m [K=1.0723]
Remarks:

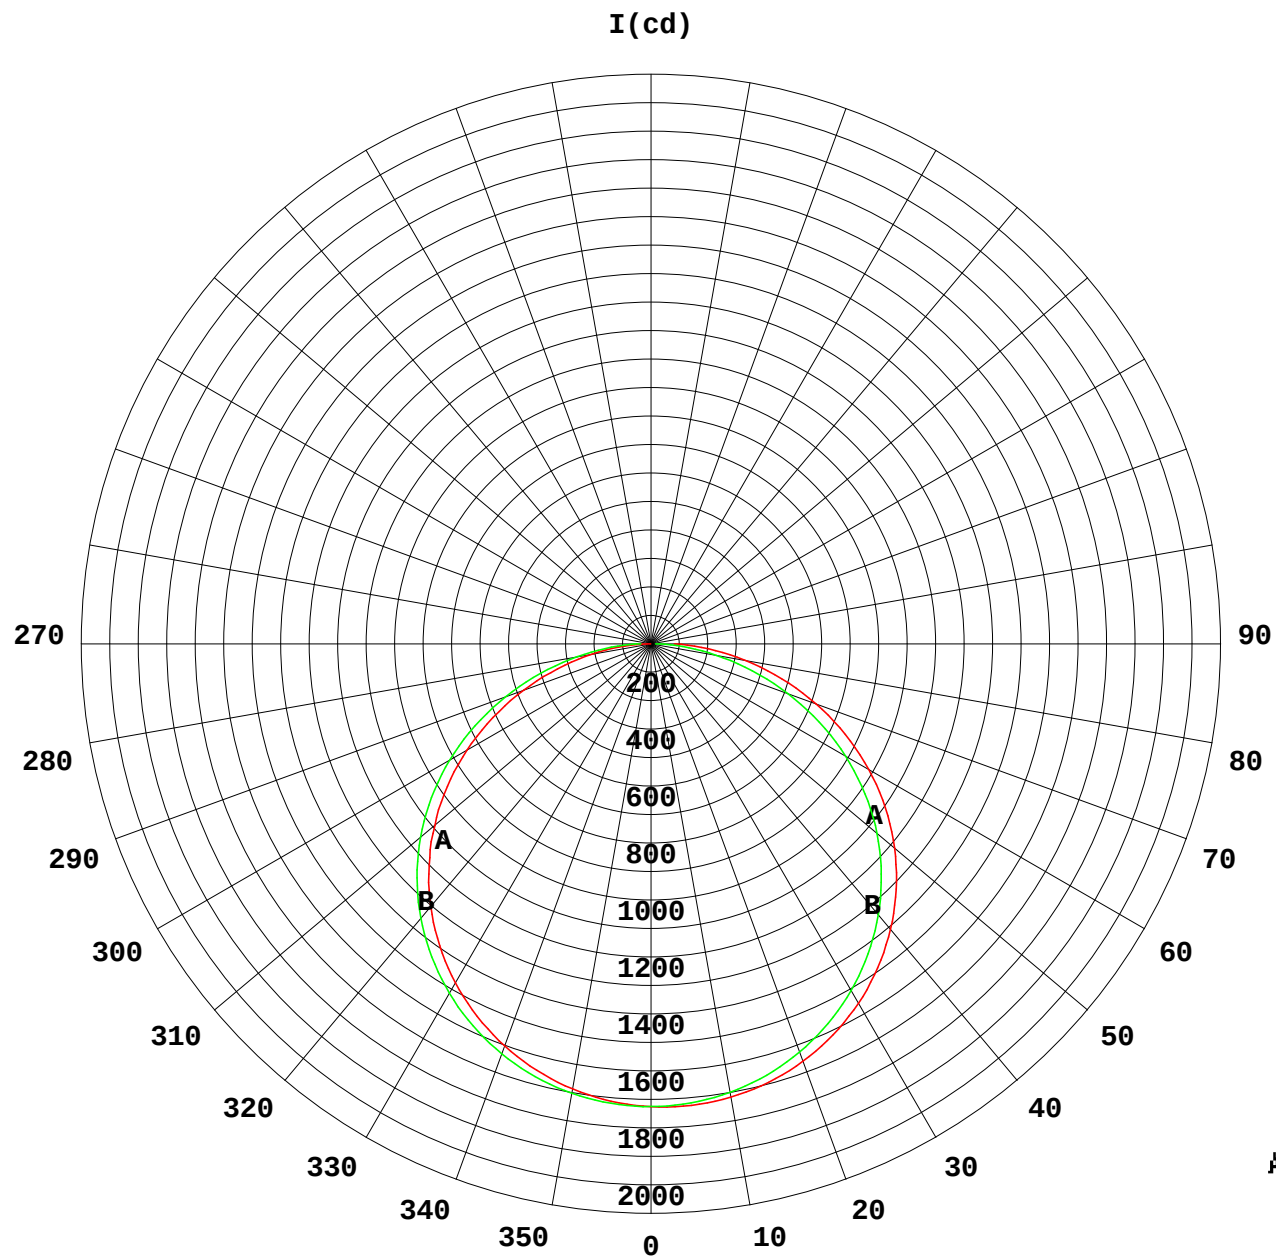

1000 lm

K = 1

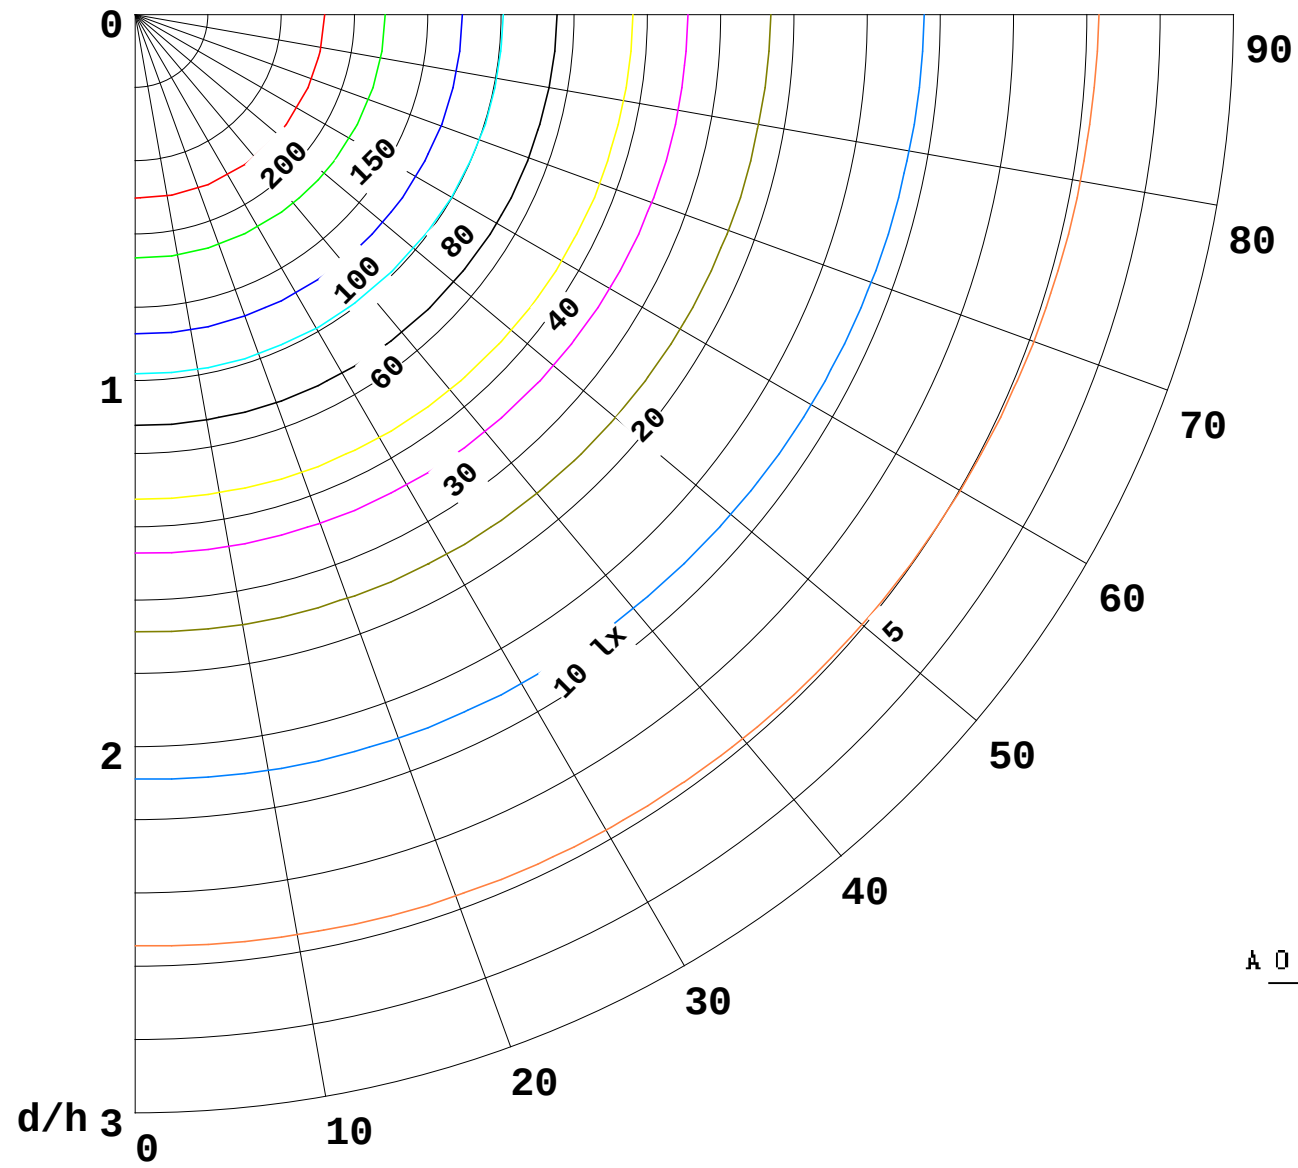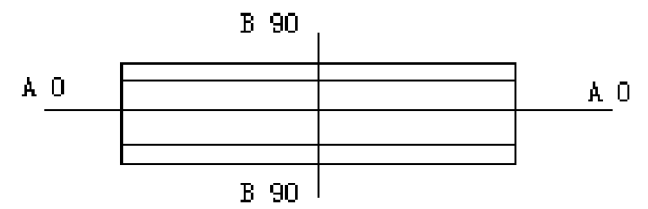

F = 5000 lm
K = 0.7
Hcc = 0.0 m
Hfc = 0.0 m
Eave = 100 lx

	Pcc	Pw	Pfc
_____	70	50	30
_____	50	30	20

